

Smart Physical Instrument
智能人體理療儀

OlyLife THz Smart Physical Instrument-P90
P-90太赫茲兆能儀

廣西巴馬
世界長壽之鄉



廣西巴馬——世界長壽之鄉







中國廣西巴馬地區，總人口23.62萬人，

其中百歲老人**102人**，占比0.04%。

是世界五大長壽之鄉中百歲老人分佈率最高的地區，

被譽為“**世界長壽之鄉·中國人瑞聖地**”。

——數據來自廣西地方政府官方網站

人類賴以生存的五大要素



陽光



空氣



水



食物




地磁

巴馬的長壽密碼

廣西巴馬地區的地磁強度，
高達0.58高斯，
是其他地區的**2-3倍**。
百魔洞裏地磁強度更比外面
高**1倍**之多。

在百魔洞裏打坐，
可以**疏通經絡，**
促進血液迴圈，
降低血液粘稠度，
提高細胞新陳代謝，
增強免疫力等作用。

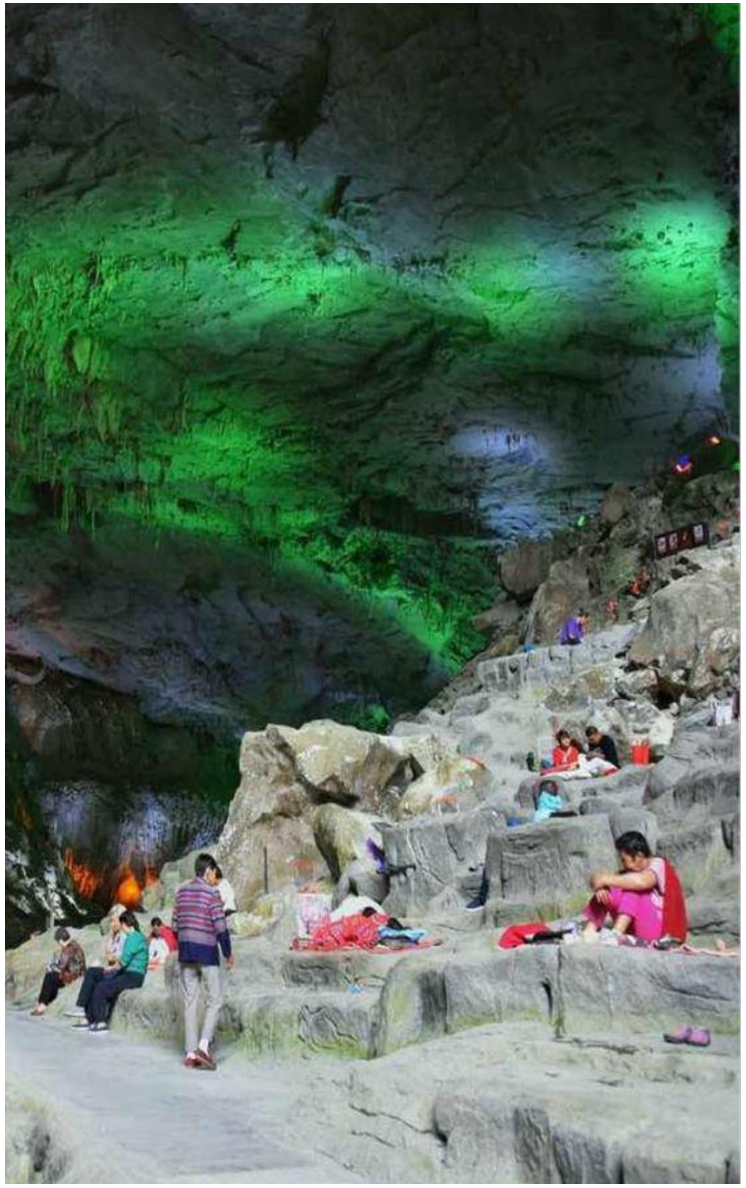






長壽之星——羅美珍

出生於1885年（清光緒年間），逝於2013年，歷經3個世紀，活了128歲。

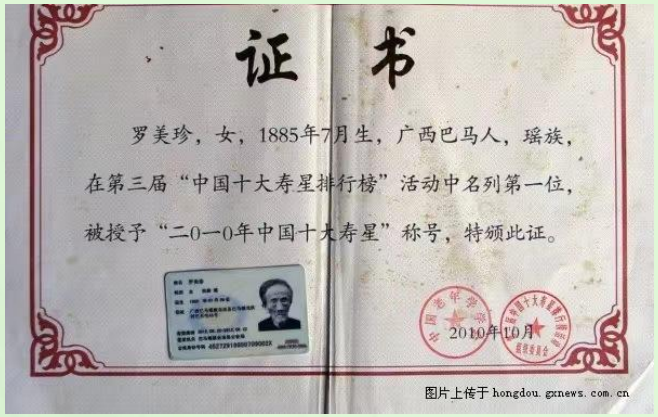
证 书

罗美珍，女，1885年7月生，广西巴马人，瑶族，在第三届“中国十大寿星排行榜”活动中名列第一位，被授予“二0一0年中国十大寿星”称号，特颁此证。

2010年10月


图片上传于 hongdou.gxnews.com.cn

羅美珍的**長壽密碼**是什麼呢?

答案是她從來不穿鞋，可以說**光腳**生活了一輩子。

科學家解釋：羅美珍常年光腳，非常“**接地氣**”，能充分感受到**地磁能量**！加之人的**腳底彙聚多條經絡和重要穴位，直接刺激加吸納地磁**，能**疏通經絡，增強細胞活性，促進血液迴圈等**，因而能保持健康狀態。

地磁到底是什麼?

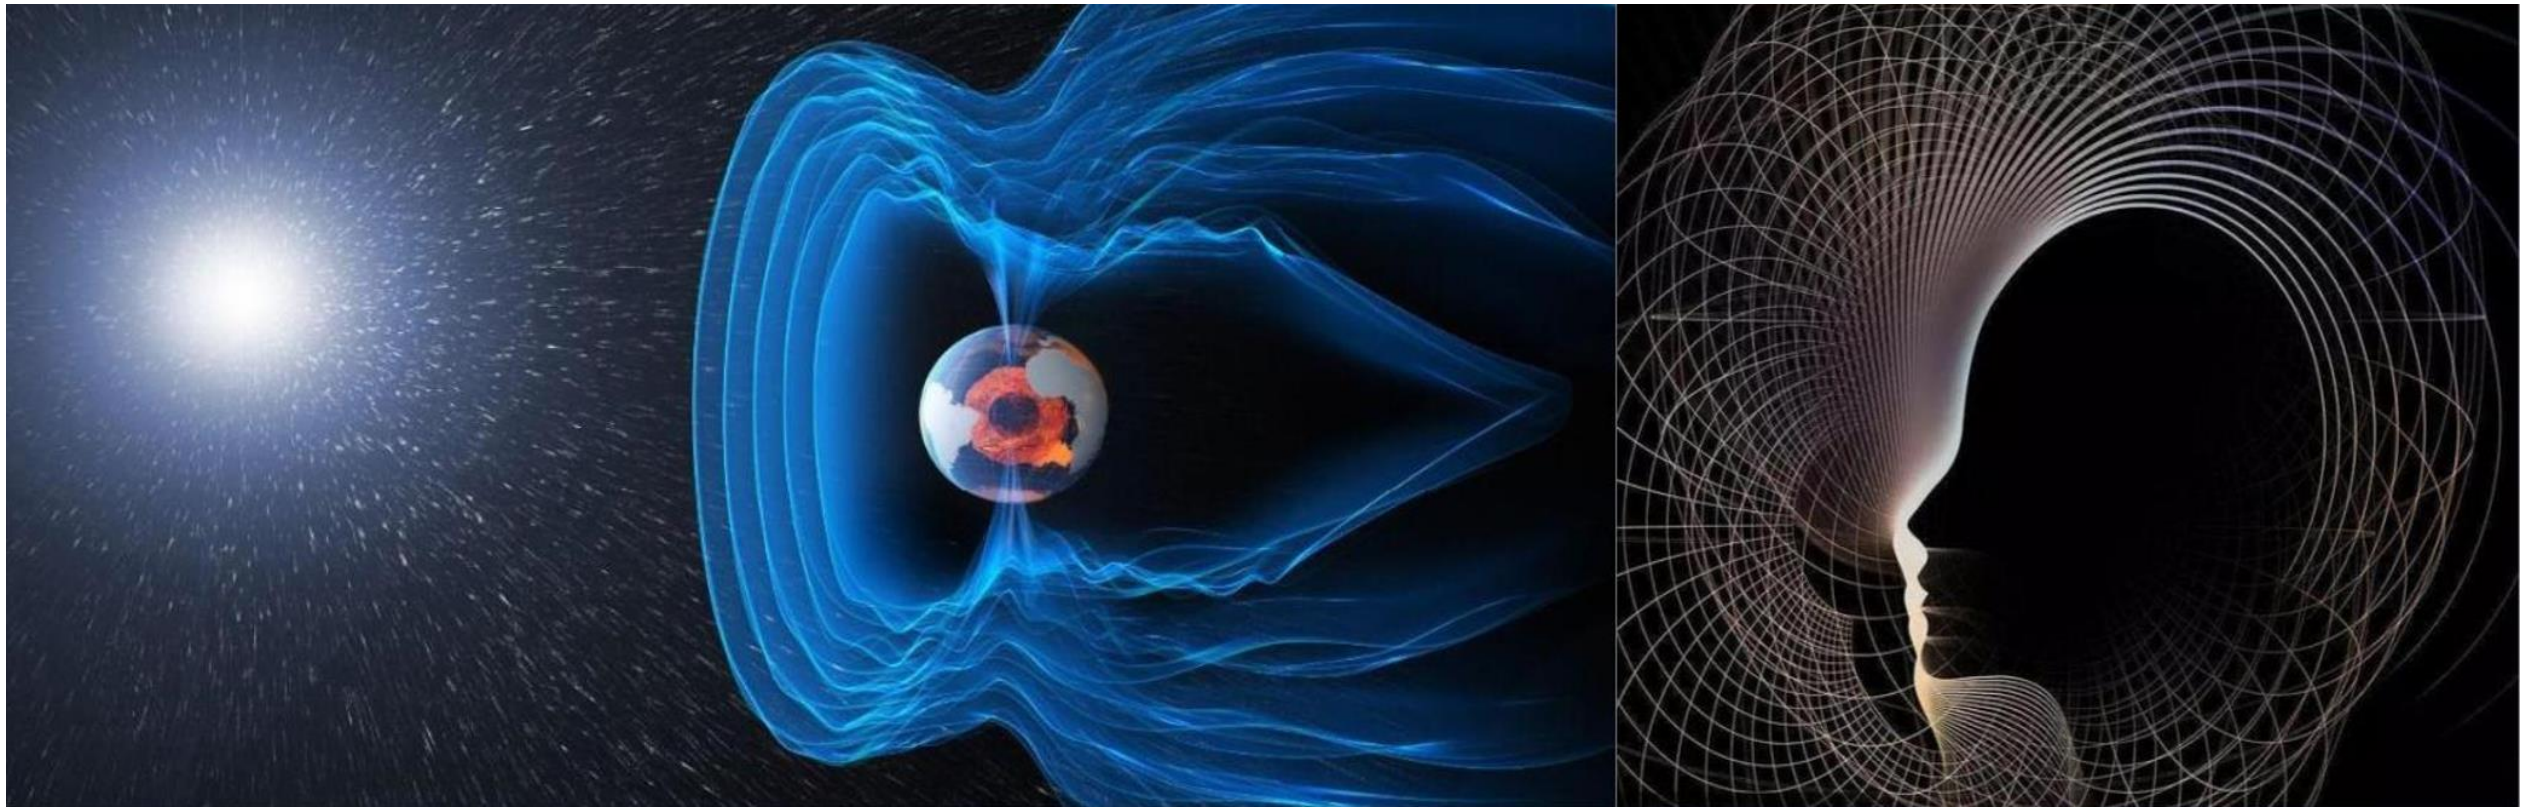

- 地球磁場對外像一件**防曬衣**，對內像一個**充電器**，對人類的生存具有重要意義。
- 但有資料顯示，地球的磁場正有**逐步減弱**，加之現代人生活在鋼筋混凝土的建築物裏，乘坐在鋼鐵製造的交通工具上，使得人體獲得的磁力越來越低。這種**去磁化的效應**，對血液迴圈、細胞活性、新陳代謝、神經系統功能可產生不良影響。

NASA的小白鼠磁遮罩實驗

美國國家宇航局（NASA）做了一個實驗，將小白鼠放在金屬製成的磁遮罩室內。經過一段時間觀察發現，生活在磁遮罩室的小白鼠變得不活躍，甚至出現皮毛脫落，喪失生育功能，許多小白鼠過早死去。磁遮罩室的小白鼠**平均壽命縮短了40%**，相當於人的壽命從**70歲縮短到了40歲**。

通過以上實驗證明：**長期受磁場削弱的影響，會導致生理和生化性質改變，影響細胞的正常功能，進而組織和器官形態和功能產生變化，甚至造成過早的死亡等。**

人體長期缺磁（磁饑餓）帶來的問題



頭昏頭痛

失眠乏力

便秘

心慌心悸

血壓不穩

關節疼痛

情緒暴躁

內分泌紊亂

記憶力減退

耳鳴等



脈衝電磁場療法（PEMF）



航天科技

1969年美國國家宇航局（NASA）
為宇航員恢復健康，包括降低骨質流失和肌肉萎縮而研究的治療成果。



太空人進入
三個月左右的恢復療養期

醫監醫保部門還會安排太空人進入三個月左右的恢復療養期，**通過PEMF等療法將太空人各項生理參數恢復到飛行前的狀態。**提高心血管系統和支持運動器官功能，提高立位耐力，消除飛行後疲勞。

脈衝電磁場（PEMF）療法的科學研究

Progress of pulsed electromagnetic fields´ effect on tissue wound repair

NIU Ying-ying[1] *reviewing*, JIAO Ming-ke[2] *checking*
(1. *Xinjiang Medical University*, *Urumqi* 830000, *Xinjiang*, *China*; 2. *Department of Biomedical Engineering*, *General Hospital of Xinjiang Military Area Command*, *Urumqi* 830000, *Xinjiang*, *China*)

【Abstract】 A large number of studies have confirmed that pulsed electromagnetic fields (PEMF) can promote tissue repair, and some related studies have achieved remarkable results with being applied to clinical practice. Therefore, it is important to analyze and summarize the advances of the biological effects of PEMF on tissue wound repair. Initially, the applied research results of PEMF are described in the repair of different tissues. Besides, the mechanism of biological effects of PEMF is analyzed. At last, a scientific conception for the research of PEMF on tissue repair is put forward and provides a possible theoretical basis for expanding the application of PEMF.

【Key words】 pulsed electromagnetic fields(PEMF); tissue repair; wound healing; biological effect; mechanism of action

PEMF在促進組織創傷的修復和再生

Clinical research progress of pulsed electromagnetic field in the treatment of osteoporosis

YANG Jiancheng[1], ZENG Yuhong[1*]
Department of Osteoporosis, Honghui Hospital, Xi'an Jiaotong University, Xi'an 710054, China
* Corresponding author: ZENG Yuhong: Email: xahhzyh@163.com

Abstract: Pulsed electromagnetic field (PEMF), as a non-invasive, safe and effective physical therapy, is first applied in treating patients with delayed healing and non-union of fractures, and is now used as a clinical adjunct in the treatment of osteoporosis. In vitro and animal studies have demonstrated that PEMF stimulates bone formation by osteoblasts and inhibits bone resorption by osteoclasts, ultimately achieving structural integrity of bone and preservation of bone mass and bone strength. A large number of clinical studies have also shown that PEMF has satisfactory therapeutic effect on increasing bone mineral density, relieving pain, and improving life quality of patients with osteoporosis. However, the certainty of the positive effects of PEMF on osteoporosis still needs to be further investigated. In this review, we summarize the relevant clinical literature on PEMF for the treatment of osteoporosis in the domestic and overseas, and discuss the possible mechanisms, aiming to provide some reference for future clinical

PEMF治療骨質疏鬆症

Progress of Low Frequency Pulsed Electromagnetic Fields against Neurological Disease

WEI Qing-chuan, LI Yi, HE Cheng-qi, YANG Lin
(*Center of Rehabilitation Medicine, West China Hospital, Sichuan University, Rehabilitation Key Laboratory of Sichuan Province, Chengdu, 610041*)

Abstract: Low frequency pulsed electromagnetic fields is a non-invasive and safe physical therapy, and it has been used as a clinical adjuvant treatment of bone fracture, osteoarthritis, femur head necrosis, osteoporosis and cartilage injury. In addition to the effect of promoting fracture healing and the proliferation of chondrocytes, and increasing bone density, recent researches have shown that low frequency pulsed electromagnetic fields have the potential to treat neurological disease and ameliorate nerve injury symptoms. Therefore, this paper reviewed the progress of efficacy and mechanism of low frequency pulsed electromagnetic fields on stroke, Parkinson's disease and multiple sclerosis, so as to provide some new idea for the treatment of the diseases.

Key words: low frequency pulsed electromagnetic fields; stroke; Parkinson's disease; multiple sclerosis

PEMF治療神經系統疾病（腦卒中、帕金森等）

PEMF THERAPY AND VISION: SEEING THE DIFFERENCE

D. Todd Wylie, OD, FCOVD
Advanced Eyecare & Optical
412 E. 30th Avenue
Spokane, WASHINGTON 99203 USA

Introduction

By 2020, one third of the U.S. population will be over 60 years of age. My interests are in all areas of eye care, particularly in vision development and vision therapy, which has led me to believe there is more to eyesight than meets the eye. My other experience is with head trauma patients and nutrition.

My introduction to PEMF Therapy was through a female head trauma patient working for a government agency when her portable phone headset exploded on her head. This completely took out hearing in one ear and resulted in a concussive head injury. We provided some vision therapy and light therapy and examining near-point peripheral vision which gives a snapshot of the volume of information a person can process through the visual system. Progress was slow going until she came in for her third progress visit and her peripheral vision was 50% better. Startling difference after therapy progress had plateaued. When queried whether she had been doing anything differently patient replied she had done 5 PEMFT sessions. She also mentioned her neck and shoulders were feeling noticeably better as well. I had used PEMFT devices in the past in the office and microcurrents with macular degeneration.

PEMF眼部疾病的治療

脈衝電磁場（PEMF）療法的科學研究

OPEN

Pulsed electromagnetic fields promote osteogenesis and osseointegration of porous titanium implants in bone defect repair through a Wnt/β-catenin signaling-associated mechanism

Received: 25 February 2016
Accepted: 02 August 2016
Published: 24 August 2016

Da Jing[1,*], Mingming Zhai[1,*], Shichao Tong[1], Fei Xu[2], Jing Cai[3], Guanghao Shen[1], Yan Wu[4], Xiaokang Li[4], Kangning Xie[1], Juan Liu[1], Qiaoling Xu[5] & Erping Luo[1]

Treatment of osseous defects remains a formidable clinical challenge. Porous titanium alloys (pTi) have been emerging as ideal endosseous implants due to the excellent biocompatibility and structural properties, whereas inadequate osseointegration poses risks for unreliable long-term implant stability. Substantial evidence indicates that pulsed electromagnetic fields (PEMF), as a safe noninvasive method, inhibit osteopenia/osteoporosis experimentally and clinically. We herein investigated the efficiency and potential mechanisms of PEMF on osteogenesis and osseointegration of pTi *in vitro* and *in vivo*. We demonstrate that PEMF enhanced cellular attachment and proliferation, and induced well-organized cytoskeleton for *in vitro* osteoblasts seeded in pTi. PEMF promoted gene expressions in Runx2, OSX, COL-1 and Wnt/β-catenin signaling. PEMF-stimulated group exhibited higher Runx2, Wnt1, Lrp6 and β-catenin protein expressions. *In vivo* results via μCT and histomorphometry show that 6-week and 12-week PEMF promoted osteogenesis, bone ingrowth and bone formation rate of pTi in rabbit femoral bone defect. PEMF promoted femoral gene expressions of Runx2, BMP2, OCN and Wnt/β-catenin signaling. Together, we demonstrate that PEMF improve osteogenesis and osseointegration of pTi by promoting skeletal anabolic activities through a Wnt/β-catenin signaling-associated mechanism. PEMF might become a promising biophysical modality for enhancing the repair efficiency and quality of pTi in bone defect.

PEMF修復骨缺損（促進骨細胞再生與整合）

Research Advance in Pulsed Electromagnetic Field Therapy of Osteoarthritis

LI Lan[1], ZHOU Jun[1,2]

1. Department of Rehabilitation Medicine/Rehabilitation Medicine Center/Laboratory of Rehabilitation Medicine, the First Affiliated Hospital of the University of South China, Hengyang 421001, China; 2. Department of Rehabilitation Medicine, West China Hospital, Sichuan University, Chengdu 611130, China

Corresponding author: ZHOU Jun, Email: zhoujun8005@163.com

Abstract: Osteoarthritis is a chronic degenerative disease that can lead to joint dysfunction and disability, which is drawing much attention due to its yearly increasing prevalence rate. At present, the clinical treatment of osteoarthritis mainly focuses on relieving symptoms, preserving and improving joint function. Pulsed electromagnetic field (PEMF) therapy is one of the physical therapy methods for the treatment of osteoarthritis, which has the advantages of non-invasiveness, low cost, simple operation and good safety, and gradually attracts wide attention because of its capability of improving the osteoarthritis dysfunction through multiple ways. The optimal parameter range for the maximum therapeutic effect of PEMF in the treatment of osteoarthritis, its synergistic effect in combination with other treatments, and the safety of the clinical application are the research directions in the future.

Key words: Osteoarthritis; Pulsed electromagnetic field; Physical factor therapy

PEMF治療骨關節炎

Design and implementation of an extremely low frequency pulsed electromagnetic field system for diabetic complications

PAN Wei[1,2], PAN Wei-dong[1], XU Jing-jing[1,2], KONG Xiang-yang[1,2]

(1. Beijing Key Laboratory of Bioelectromagnetics, Institute of Electrical Engineering, Chinese Academy of Sciences, Beijing 100190, China;
2. University of Chinese Academy of Sciences, Beijing 100049, China)

Abstract: As a lifelong metabolic disease, the diabetes has many complications. Studies have shown that pulsed magnetic field can promote the deposition of collagen fibers, improve the orientation and arrangement of collagen fibers, help diabetic wound healing, and take effects in promoting the healing of venous ulcers. To further explore the intensity, pulse width, frequency and duration of the extremely low frequency pulsed electromagnetic field (PEMF) for the treatment of diabetic complications, a new scheme was proposed in this study. Following the scheme, the low frequency pulsed electromagnetic field with the intensity from 0 to 100mT and the frequency from 0 to 100Hz was designed based on the STM32 microcontroller technology. The ANSYS software was used to analyze the magnetic field distribution of the coil to optimize the structure. As the core component, the STM32 MCU implements real-time measurements and control of production process. The pulse width was shortened by choosing switching devices and optimizing coils and commutating circuits. The temperature rise with coils was restricted by optimizing the structure of coils. The test experiments showed that the new pattern of PEMF was easy to use with stable

PEMF治療糖尿病併發症

The efficacy and safety of the combination of photobiomodulation therapy and pulsed electromagnetic field therapy on androgenetic alopecia

Mi Soo Choi MD[1] | Byung Cheol Park MD, PhD[1,2]

[1]Department of Dermatology, Dankook University Hospital, Cheonan, Republic of Korea
[2]Beckman Laser Institute Korea, Cheonan Campus, Dankook University, Cheonan, Republic of Korea

Correspondence
Byung Cheol Park, Dankook University Hospital, Department of Dermatology, 201, Manghyang-ro, Dongnam-gu, Cheonan, Chungcheongnam-do, Republic of Korea.
Email: 4exodus@hanmail.net

Funding information
Korea Health Industry Development Institute; Korea Medical Device Development Fund

Abstract

Background: Photobiomodulation therapy (PBMT) appears to be safe and effective for hair loss. Pulsed electromagnetic field therapy (PEMF) also has a positive biological effect on hair re-growth.

Objectives: We evaluated the efficacy and safety of both PBMT and PEMF for the treatment of androgenetic alopecia (AGA).

Materials and Methods: This study was a 24-week, randomized, double-blind, sham device-controlled trial. We recruited 80 subjects with androgenetic alopecia. The subjects got treatment every week for the 1st 12 weeks, every other week for the next 8 weeks. PBMT entails 15-min therapy, and PEMF was carried out for 10 min.

Results: The baseline hair density was 114.57 (±28.75)/cm^2 and 113.31 (±30.07)/cm^2 in both treatment and control groups. After 24 weeks of treatment, the mean hair density increased to 139.37 (±31.4)/cm^2 in the treatment group but only to 119.78 (±31.92)/cm^2 in the control group. The difference between two groups was statistically significant ($p < 0.05$). Based on the global assessment of independent experts, the score was 0.41 (±0.62) in the treatment group and 0.07 (±0.45) in the control group. Only very mild erythema or irritation was reported, and no serious adverse reactions were reported.

Conclusions: A combination of PBMT and PEMF is a valid and safe treatment option for AGA.

KEYWORDS
androgenetic alopecia, LLLT, low-level laser therapy, photobiomodulation therapy, pulsed electromagnetic field therapy

PEMF治療脫髮（促进毛囊细胞再生）

脈衝電磁場（PEMF）療法的科學研究

Effects of pulsed electromagnetic fields on acute hindlimb ischemia diabetic rats in microcirculation angiogenesis

Candidate for master: Pan Yun hu
Supervisor:Guo Wen yi
Department of Cardiovasology, Xijing hospital, Fourth Military Medical University,
Xi'an 710032, China

Abstract

Background

Ischemic diseases, particularly in diabetics, result in significant morbidity and mortality and have a profound economic impact. To ischemic disease, therapeutic angiogenesis is the focus of current research.Stem and progenitor cell therapy， protein of promoting angiogenesis factor therapy and gene therapy were the main methods to improve neovascularization and function of ischemic tissue. These methods in ischemic diseases have certain effect, but they were expensive, technically, especially to our country of lack of medical resources，it is still very difficult for the general clinical promotion. Therefore, we need an effective treatment..

PEMF促進血管再生

Maria Radeva，Maya Lambrera，Plamena Angelova，Nelly Traitcheva，Hermann Berg
（*Laboratory of Bioelectrochemistry，Campus Beutenberg，Jena，Germany*）

Abstract：Weak pulsating sinusoidal electromagnetic fields（PEMF）have been applied to change membrane permeation and induction of apoptosis（necrosis）. In the case of suspension of human cancer cells U-937 and K-562 inside of Helmholtz-coils the amplitude of PEMF $B = 10$ and at 39mT（at 50 Hz）was combined gradually with the cytotoxic agent actinomycin-C on one hand with its novel photodynamic activity on the other.

Depending on temperature，pH-value and treatment time the necrosis of these cells was determined by means of trypan blue staining as well as the induced apoptosis by FACScan technique. Synergisms were discovered yielding high rates of cell death for three combinations：

I. PEMF + hyperthermia or（and）hyperacidity
II. PEMF + cytostatic drugs in the dark
III. PEMF + cytostatic drugs irradiated by visible light（photodynamic effect）

The selection of cytostatic drugs as actinomycin-C and some anthracyclines was to prove their photodynamic activity，which is suitable to enhance their cytotoxic effects.

PEMF促進癌細胞失活和壞死

Microcirculatory effects of pulsed electromagnetic fields

Thomas L. Smith *, Donna Wong-Gibbons, Jane Maultsby
Department of Orthopaedic Surgery, Wake Forest University School of Medicine, Medical Center Blvd., Winston-Salem, NC 27157-1070, USA
Received 27 September 2002; accepted 9 June 2003

Abstract

Purpose: Pulsed electromagnetic fields (PEMF) are used clinically to expedite healing of fracture non-unions, however, the mechanism of action by which PEMF stimulation is effective is unknown. The current study examined the acute effects of PEMF stimulation on arteriolar microvessel diameters in the rat cremaster muscle. The study hypothesis was that PEMF would increase arteriolar diameters, a potential mechanism involved in the healing process.

Methods: Local PEMF stimulation/sham stimulation of 2 or 60 min duration was delivered to the cremaster muscle of anesthetized rats. Arteriolar diameters were measured before and after stimulation/sham stimulation using intravital microscopy. Systemic hemodynamics also were monitored during PEMF stimulation.

Results: Local PEMF stimulation produced significant ($p < 0.001$) vasodilation, compared to pre-stimulation values, in cremasteric arterioles in anesthetized rats ($n = 24$). This dilation occurred after 2 min of stimulation (9% diameter increase) and after 1 h of stimulation (8.7% diameter increase). Rats receiving "sham" stimulation ($n = 15$) demonstrated no statistically significant change in arteriolar diameter following either "sham" stimulation period. PEMF stimulation of the cremaster ($n = 4$ rats) did not affect systemic arterial pressure or heart rate, nor was it associated with a change in tissue environmental temperature.

Conclusions: These results support the hypothesis that local application of a specific PEMF waveform can elicit significant arteriolar vasodilation. Systemic hemodynamics and environmental temperature could not account for the observed microvascular responses.
© 2003 Orthopaedic Research Society. Published by Elsevier Ltd. All rights reserved.

Keywords: PEMF; Microcirculation; Rats; Vascular mechanisms

PEMF改善微循環（擴張微小動脈）

Effects of low-intensity pulsed electromagnetic fields on cardiovascular system of rabbit

LUO Er-Ping[1,2], *JIAO Li-Cheng*[1], *SHEN Guang-Hao*[2], *WU Xiao-Ming*[2], *LU Li-Hua*[3], *XU Qiao-Ling*[4], *LIU Lu-Wei*[5]
[1]Research Center of Intelligent Information Processing, School of Electronic Engineering, Xidian University, Xi'an 710071, China, [2]Department of Military Medical Equipment & Metrology, School of Biomedical Engineering, [3]Department of Chemistry, School of Pharmacy, [4]School of Nursing, [5]Department of Outpatient, Fourth Military Medical University, Xi'an 710033, China

【**Abstract**】**AIM**: To study the effects of exposing rabbits to low-intensity pulsed electromagnetic fields（PEMFs）on the cardiovascular system. **METHODS**: Thirty female white big-eared rabbits were randomly divided into three groups. Normal group was fed with normal diet, the other two groups were fed with hypercholesterolemic diet but the magnetic group was fed in 15 Hz pulsed electromagnetic fields（8×10^{-4} T and 10 h/d）. After eight weeks, the levels of

PEMF對心腦血管疾病的預防和治療



PEMF脈衝電磁場療法的作用

細胞的“充電器”

骨頭的“修復師”

新陳代謝的“加速器”

疼痛的“撫慰劑”

迴圈的“疏通劑”

炎症的“滅火器”

衰老的“減速器”

夜晚的“催眠劑”

身體整體健康的“守護神”

P-90太赫茲兆能儀

雙重能量
功效加倍



- 仿生學原理模擬地球磁場
- 1Mhz 高強度能量轉移
- 從腳開始作用到全身
- 啟動細胞
- 促進新陳代謝


PEMF

- 8-15μm聚焦波段，生命之光
- 和身體分子發生同頻共振生熱，改善微循環
- 穿透力好， 可深入皮下3-5cm
- 安全無傷害


太赫茲

太赫茲波與人體細胞同頻共振

- 20世紀80年代，美國科學家發現一種**與正常細胞振動頻率一致**的光線——太赫茲波。
- 這種共振效應可以**增加血液流動性，降低血液粘稠度，增強細胞活性以及提高新陳代謝。**

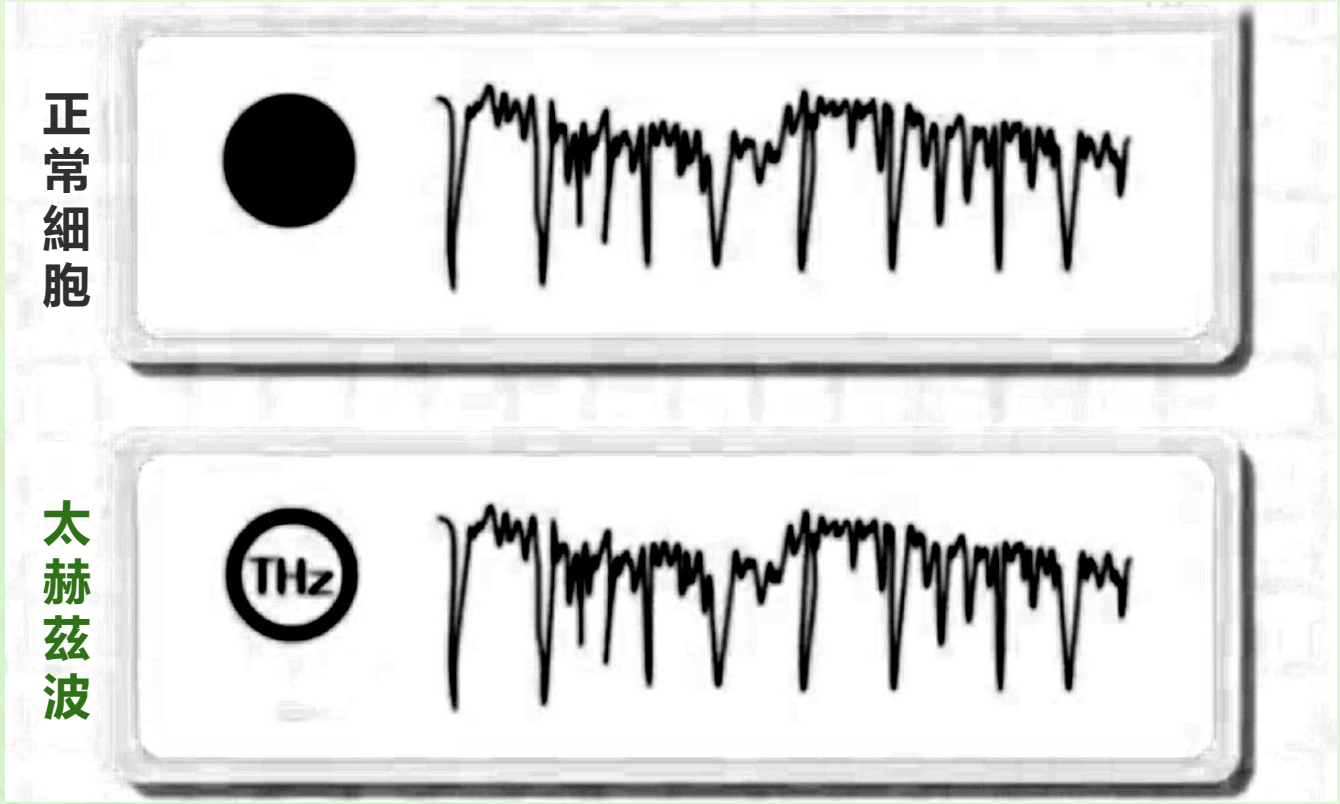

太赫茲——生命光線

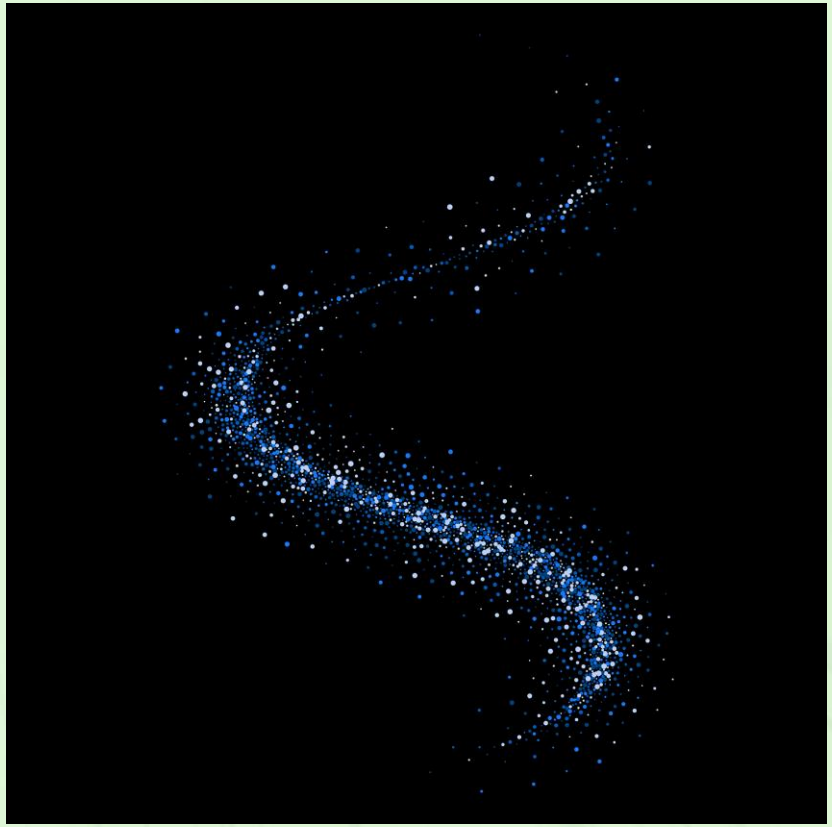

太赫茲波可穿透人體肌膚**3~5**釐米，

直接作用於**深層組織**，補充生命細胞能量。

被譽為

“生命光線”

我們採用的是**8-15μm**精准太赫茲波


能更好的與人體相容（人體波段9μm）


“百病寒中生，溫度決生死”

人体最健康、活动最灵活的体温是**36.5-37℃**。

体温比正常值上升**1℃**，免疫力就会提升**5-6倍**。

相反地，当体温下降1℃，免疫力会降低30%以上，体内细胞代谢将减少约20%。

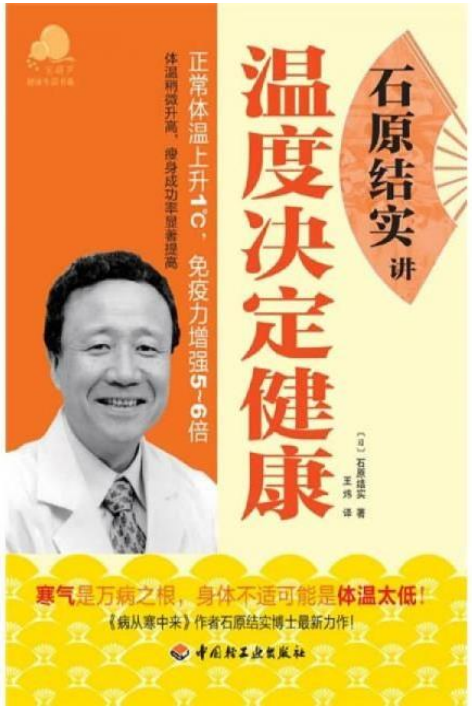

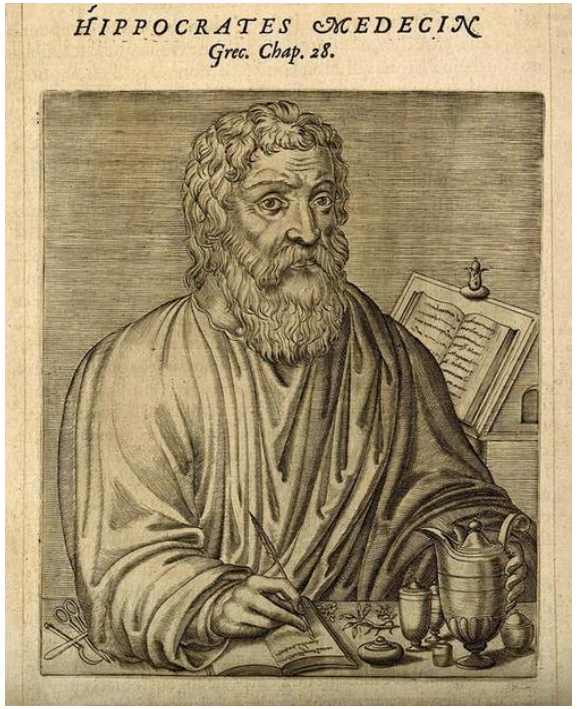

寒濕體質——萬病之源

虛則寒—>寒則濕—>濕則凝—>凝則瘀—>瘀則堵—>堵則瘤—>瘤則癌

太赫茲兆能儀
智享健康生活





一活 活化細胞 啟動細胞能量

二促 促進微循環 新陳代謝

三疏 疏通經絡 疏通血管

四排 排除寒濕、體內垃圾

五燃 燃脂塑形

六緩 舒緩炎症、疼痛、疲勞

長期使用
P-90太赫茲兆能儀
六大作用

適用人群


日常保健　緩解疲勞　改善睡眠　改善老年人健康　改善免疫力低下











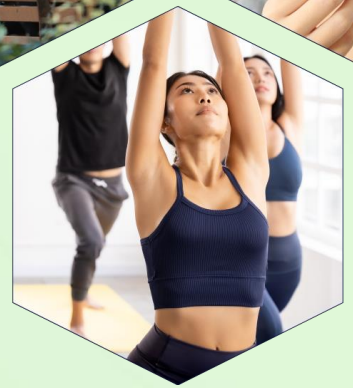



改善亞健康　手腳冰涼、麻痹　體重管理　強化肌肉　舒緩關節疼痛

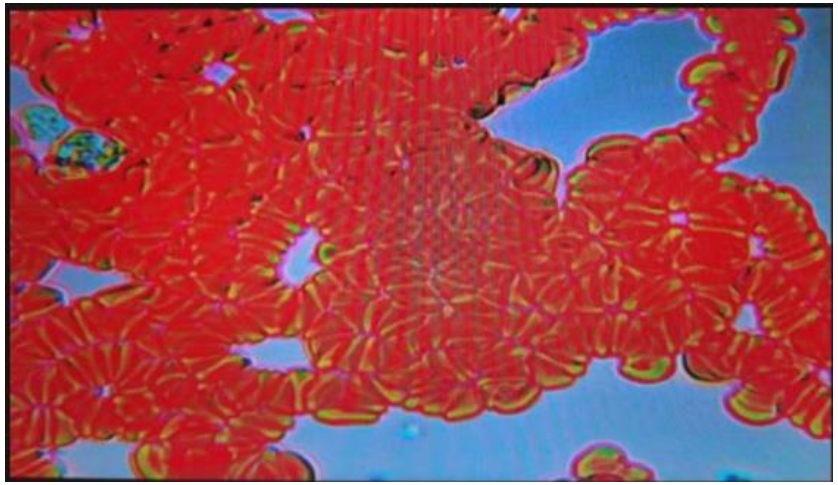

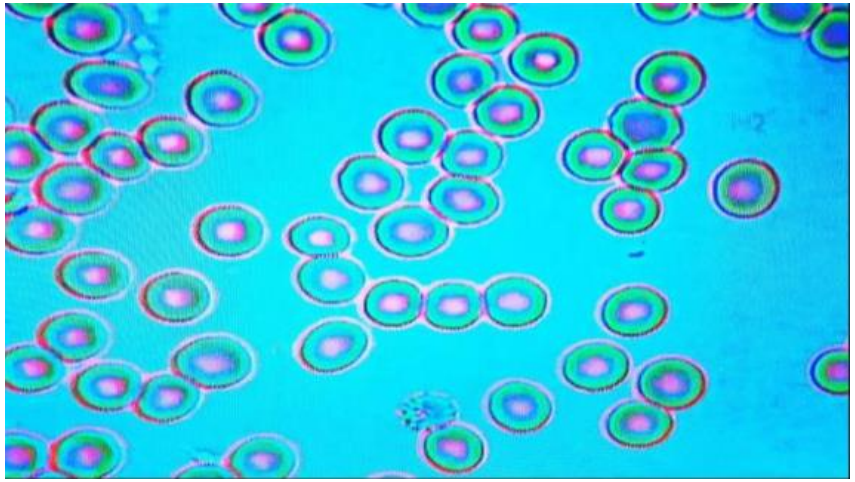

27歲 男性 使用半小時前後對比



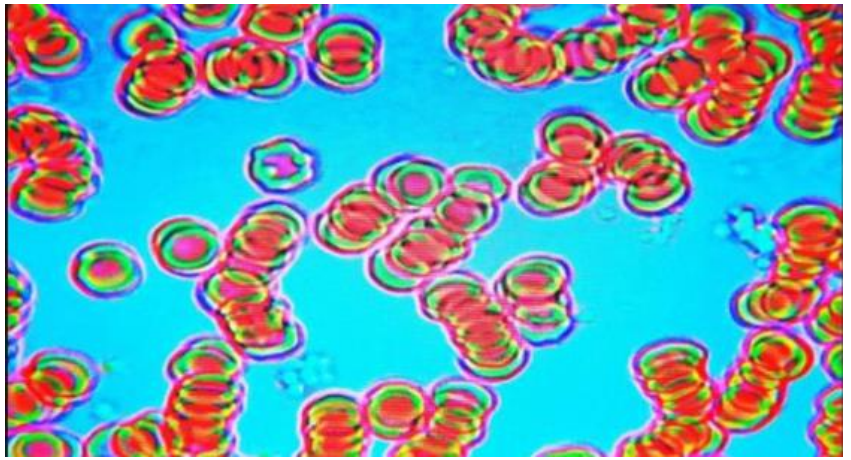

45歲 女性 使用半小時前後對比





改善靜脈曲張：一個月的效果





改善靜脈曲張：三個月的效果

使用前後的
淤血改善








使用後水腫的改善

使用後血壓的改善

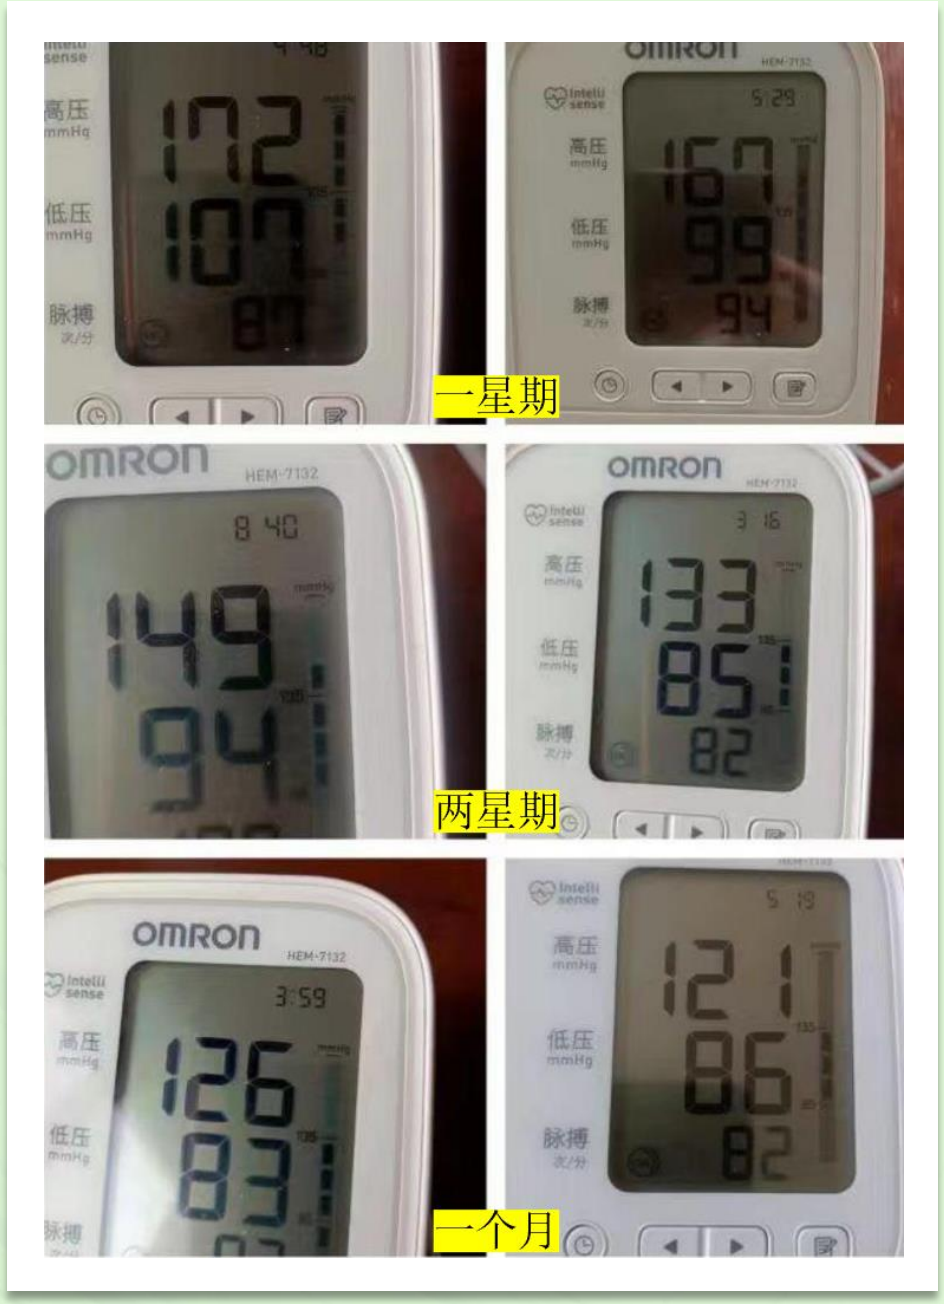

使用後血糖的改善



使用後供血功能的改善



還有很多案例……

只要用，就有驚喜！

P-90太赫茲兆能儀——使用方法

1、將儀器放置在平整的地面，接通電源，打開開關，**坐姿光腳**踩在能量板上，即開始工作。

2、先從**低強度**開始，適應後，根據自身的承受能力調整能量強度，強度調節為10檔。

3、每次使用以**20-30分鐘**為宜，一天不超過**二次**。

4、不可來回扭動身體，雙腳保持不動，切勿用手指點擊能量板，否則有炙傷危險。




溫馨提示

以下情況請謹慎使用：



1、心臟病人禁用；
2、孕婦、嬰幼兒禁用；
3、肺功能障礙者禁用；
4、意識有障礙者禁用；
5、體溫超過37℃以上禁用；
6、使用維持生命的人工心肺機等設備者禁用；
7、有出血傾向者（如子宮肌瘤、月經期等）禁用；
8、熱敏感不明顯者（如腰椎間盤突出壓迫神經，糖尿病足或其他疾病導致下肢感覺不敏感）禁用；
9、植入有心髒起搏器的患者及其他金屬人造器官攜帶者，金屬植入物者禁用；
10、嚴重高血壓患者（收縮壓≥160或舒張壓≥110）嚴禁使用；
11、14歲以下少年兒童不建議使用。

P90獲得高標準國際認證

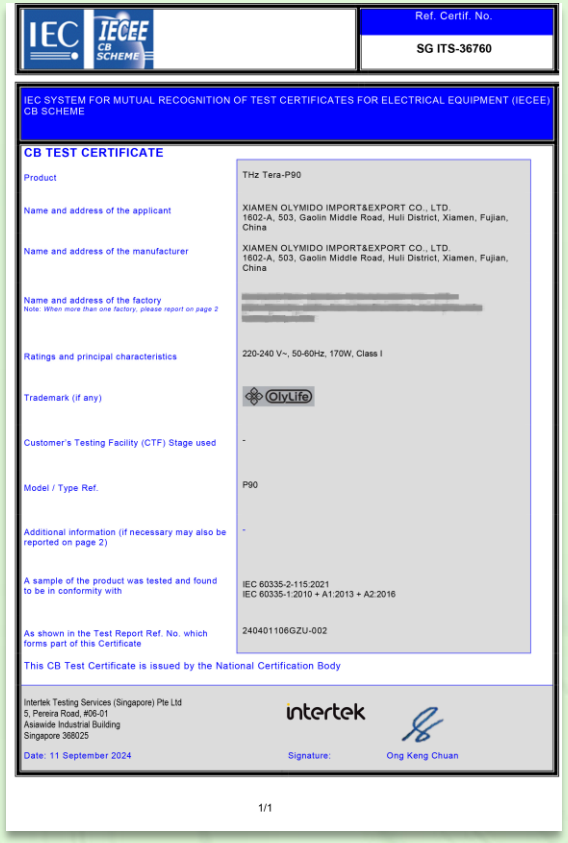

IEC IECEE CB SCHEME

Ref. Certif. No.
SG ITS-36760

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product	THz Tera-P90
Name and address of the applicant	XIAMEN OLYMIDO IMPORT&EXPORT CO., LTD. 1602-A, 503, Gaolin Middle Road, Huli District, Xiamen, Fujian, China
Name and address of the manufacturer	XIAMEN OLYMIDO IMPORT&EXPORT CO., LTD. 1602-A, 503, Gaolin Middle Road, Huli District, Xiamen, Fujian, China
Name and address of the factory *Note: When more than one factory, please report on page 2*	[redacted]
Ratings and principal characteristics	220-240 V~, 50-60Hz, 170W, Class I
Trademark (if any)	OlyLife
Customer's Testing Facility (CTF) Stage used	-
Model / Type Ref.	P90
Additional information (if necessary may also be reported on page 2)	-
A sample of the product was tested and found to be in conformity with	IEC 60335-2-115:2021 IEC 60335-1:2010 + A1:2013 + A2:2016
As shown in the Test Report Ref. No. which forms part of this Certificate	240401106GZU-002

This CB Test Certificate is issued by the National Certification Body

Intertek Testing Services (Singapore) Pte Ltd
5, Pereira Road, #06-01
Asiawide Industrial Building
Singapore 368025

intertek

Date: 11 September 2024

Signature: Ong Keng Chuan

1/1

CB認證
(國際電工委員會認證)



intertek
Total Quality. Assured.

Test Verification of Conformity

Verification Number: 240311126GZU-VOC001

On the basis of the tests undertaken, the sample<s> of the below product has been tested by an accredited 3rd party laboratory in accordance to the referenced specification<s>/standard<s> at the time the tests were carried out. This verification is part of the full test report<s> and should be read in conjunction with it <them>.

This document can be used in support of a claim in meeting relevant <EU>legislation and mandatory Conformity Marking. And in accordance with EU law, the claim is the sole obligation of the Manufacturer/ Importer.

Applicant Name & Address:	XIAMEN OLYMIDO IMPORT&EXPORT CO., LTD 1602-A, 503, Gaolin middle road, Huli District, Xiamen, Fujian, China
Product Description: Models/Type References: Ratings & Principle Characteristics: Brand Names:	Thz Tera-P90 P90 220-240 V~, 50-60 Hz, 170 W, Class I OlyLife
Specification<s>/Standards:	EN IEC 55014-1:2021 EN IEC 55014-2:2021 EN IEC 61000-3-2:2019+A1:2021 EN 61000-3-3:2013+A1:2019+A2:2021
Verification Issuing Office Name & Address:	Intertek Testing Services Shenzhen Ltd. Shunde Branch Room 202/203/204, Block 8, Tianfulai International Industrial Park, No.3, Changfu West Road, Rongli Community, Ronggui Subdistrict, Shunde District, Foshan, Guangdong, China
Date of Tests: Test Report Number(s):	12 March 2024-14 June 2024 240311126GZS-001

Signature

Name: Owen Huang
Position: Team Leader
Date: 21 August 2024

This Verification is for the exclusive use of Intertek's client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Verification. Only the Client is authorized to permit copying or distribution of this Verification. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test/inspection results referenced in this Verification are relevant only to the sample tested/inspected. This Verification by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Intertek Page 1 of 1 GFT-OP-11a (09 March 2024)

CE EMC 認證
(歐盟電磁相容性認證)



intertek
Total Quality. Assured.

Test Verification of Conformity

Verification Number: 240401106GZU-VOC001

On the basis of the tests undertaken, the sample<s> of the below product has been tested by an accredited 3rd party laboratory in accordance to the referenced specification<s>/standard<s> at the time the tests were carried out. This verification is part of the full test report<s> and should be read in conjunction with it <them>.

This document can be used in support of a claim in meeting relevant <EU> legislation and mandatory Conformity Marking. And in accordance with EU law, the claim is the sole obligation of the Manufacturer/ Importer.

Applicant Name & Address:	XIAMEN OLYMIDO IMPORT&EXPORT CO., LTD. 1602-A, 503, Gaolin Middle Road, Huli District, Xiamen, Fujian, China
Product Description: Ratings & Principle Characteristics:	THz Tera-P90 220-240 V~, 50-60Hz, 170W, Class I
Models/Type References:	P90
Brand Names:	OlyLife
Specification<s>/Standards:	Household and similar electrical appliances —Safety— EN 60335-1:2012 + A11:2014 + A13:2017 + A1:2019 + A2:2019 + A14:2019 + A15:2021+A16:2023/Part 1: General requirements EN IEC 60335-2-115: 2023+A11:2023/Part 2-115: Particular requirements for skin beauty care appliances EN 62233: 2008/ Measurement methods for electromagnetic fields of household appliances and similar apparatus with regard to human exposure Low Voltage Directive 2014/35/EU
Verification Issuing Office Name & Address:	Intertek Testing Services Shenzhen Ltd. Guangzhou Branch Room101/301/401/102/202/302/402/502/602/702/802, No. 7-2, Caipin Road, Huangpu District, Guangzhou, Guangdong, China
Date of Tests: Test Report Number(s):	01 April, 2024 to 19 Aug., 2024 240401106GZU-001: 19 Aug., 2024

Signature

Name: Amy Ao
Position: Sr. Supervisor
Date: 19 Aug., 2024

This Verification is for the exclusive use of Intertek's client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Verification. Only the Client is authorized to permit copying or distribution of this Verification. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test/inspection results referenced in this Verification are relevant only to the sample tested/inspected. This Verification by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

CE LVD 認證
(歐盟低電壓指令認證)



P-90太赫茲兆能儀

輕鬆實現智能理療生活

目前已覆蓋**100多個**國家和地區

已售出**50萬+**臺

產品受益者超**千萬人**